



DUTY CONTROL SWITCHING OF THIRD A/C UNIT



SELECT ALTERNATE SWITCH POSITION 1, 2 OR 3 AT EACH SERVICE CALL

FORCE SWITCH POSITION	ROTARY SWITCH POSITION	A/C 1	A/C 2	A/C 3
ON	1	CYCLE	CYCLE	ON
OFF	1	CYCLE	CYCLE	OFF
ON	2	CYCLE	CYCLE	ON
OFF	2	CYCLE	CYCLE	OFF
ON	3	CYCLE	OFF	CYCLE
OFF	3	OFF	OFF	CYCLE
—	4	ON	ON	ON

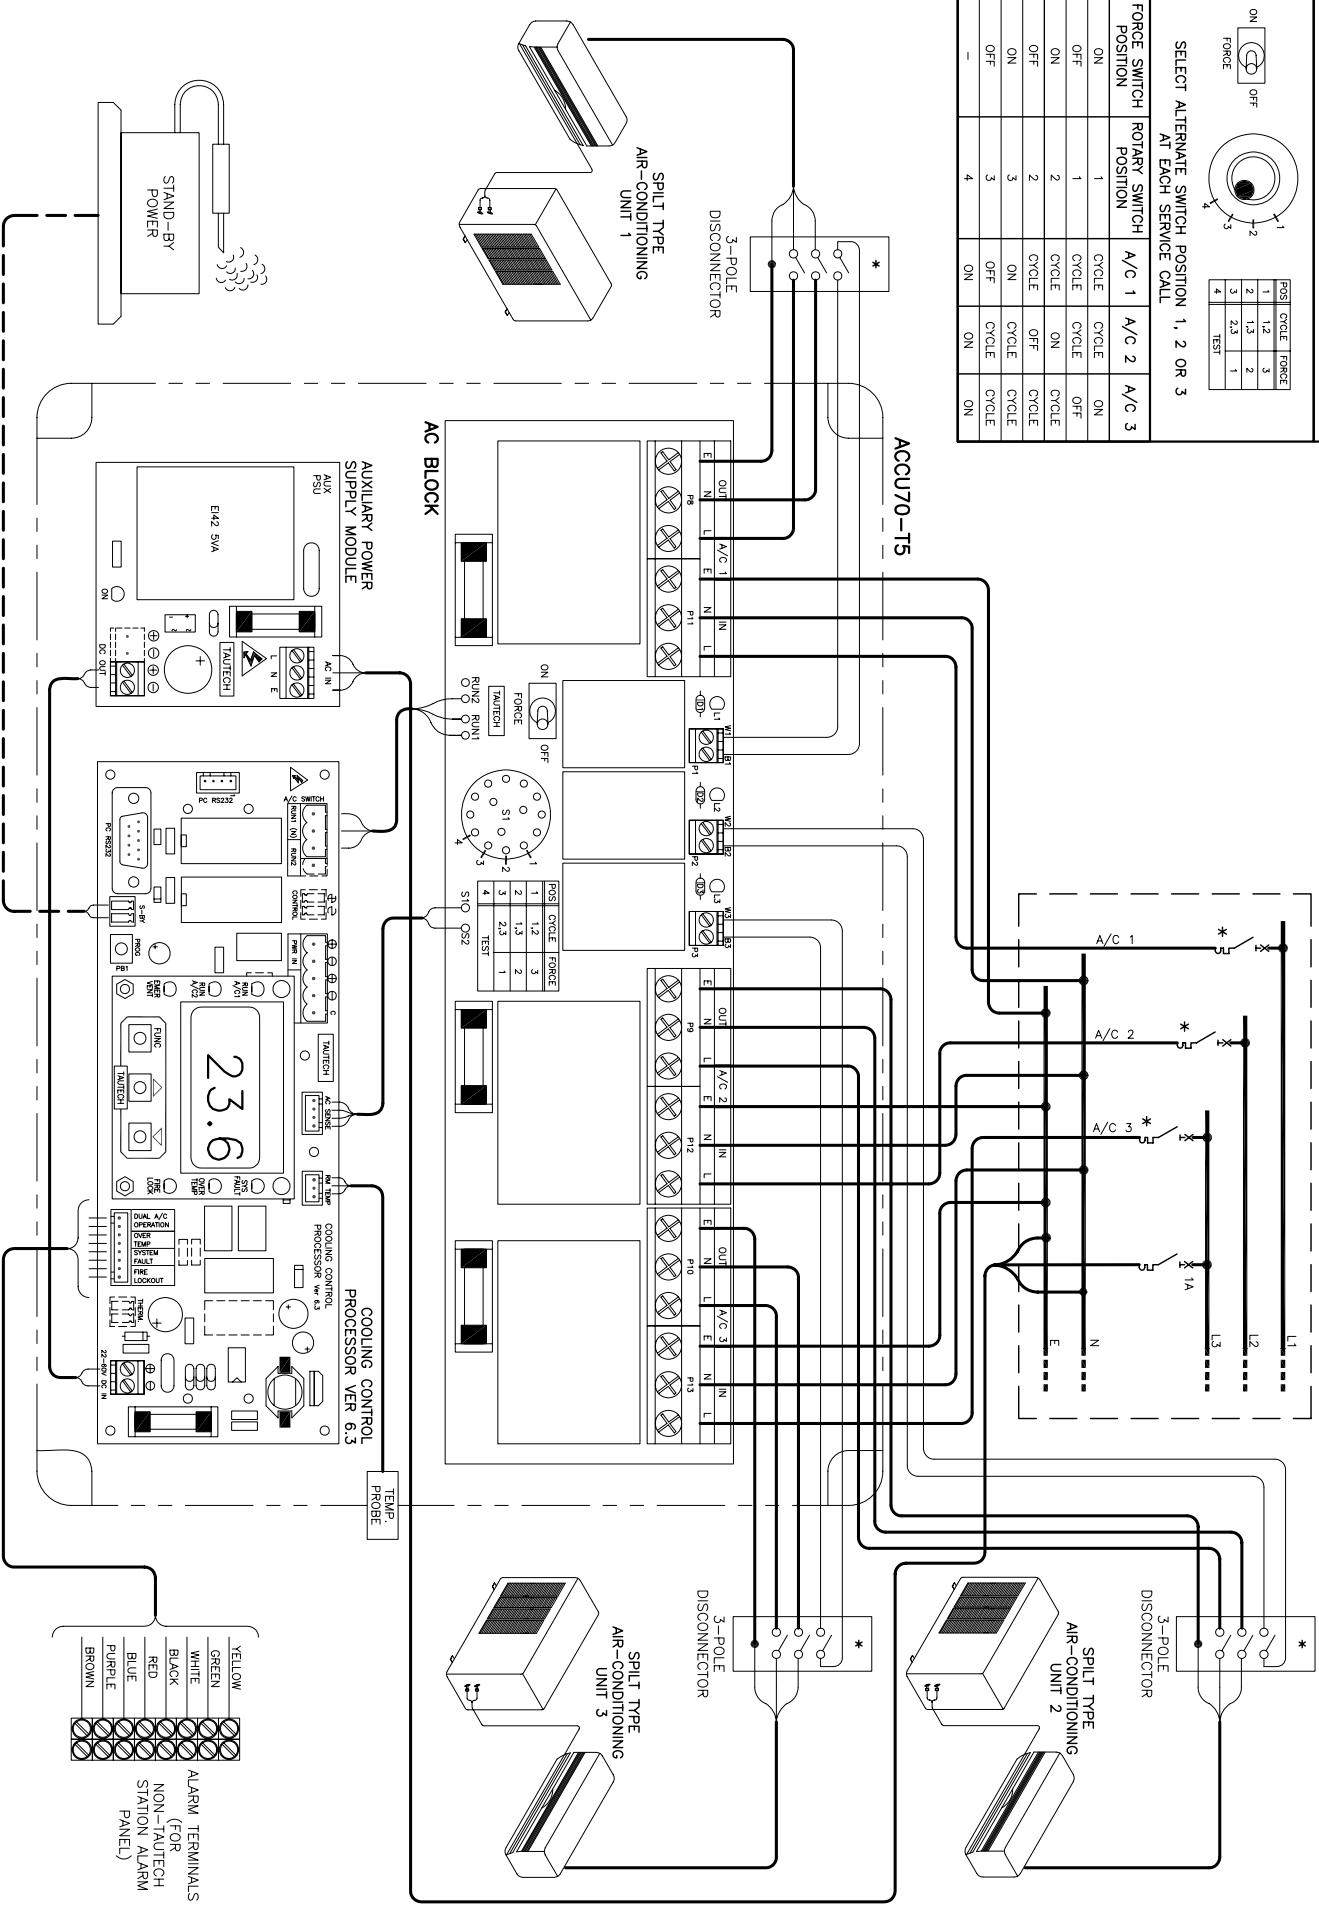

ALARM TERMINALS

YELLOW	NON-FAULTCH
GREEN	STATION ALARM
WHITE	
BLACK	
RED	
BLUE	
PURPLE	
BROWN	

79 Annie Botsch Ave  
 Randburg  
 JHB  
 SOUTH AFRICA  
 Tel: (+27 12) 329-2814  
 Fax: (+27 12) 329-2815  
 E-mail: info@tatech.co.za

P.O. Box 55689  
 Arcadia  
 Johannesburg  
 PRE 0007

SCALE: M.T.S. DATE: NOV 2005  
 DESIGNED: CH. APPROVED:  
 DRAWING NO.: ACCU-SWAY-TS