


\* CIRCUIT BREAKER, DISCONNECTOR  
 RATINGS & WIRE SIZE TO SUIT SPECIFIC  
 A/C PLANT REQUIREMENT.

AC-DB WITH SURGE SUPPRESSION

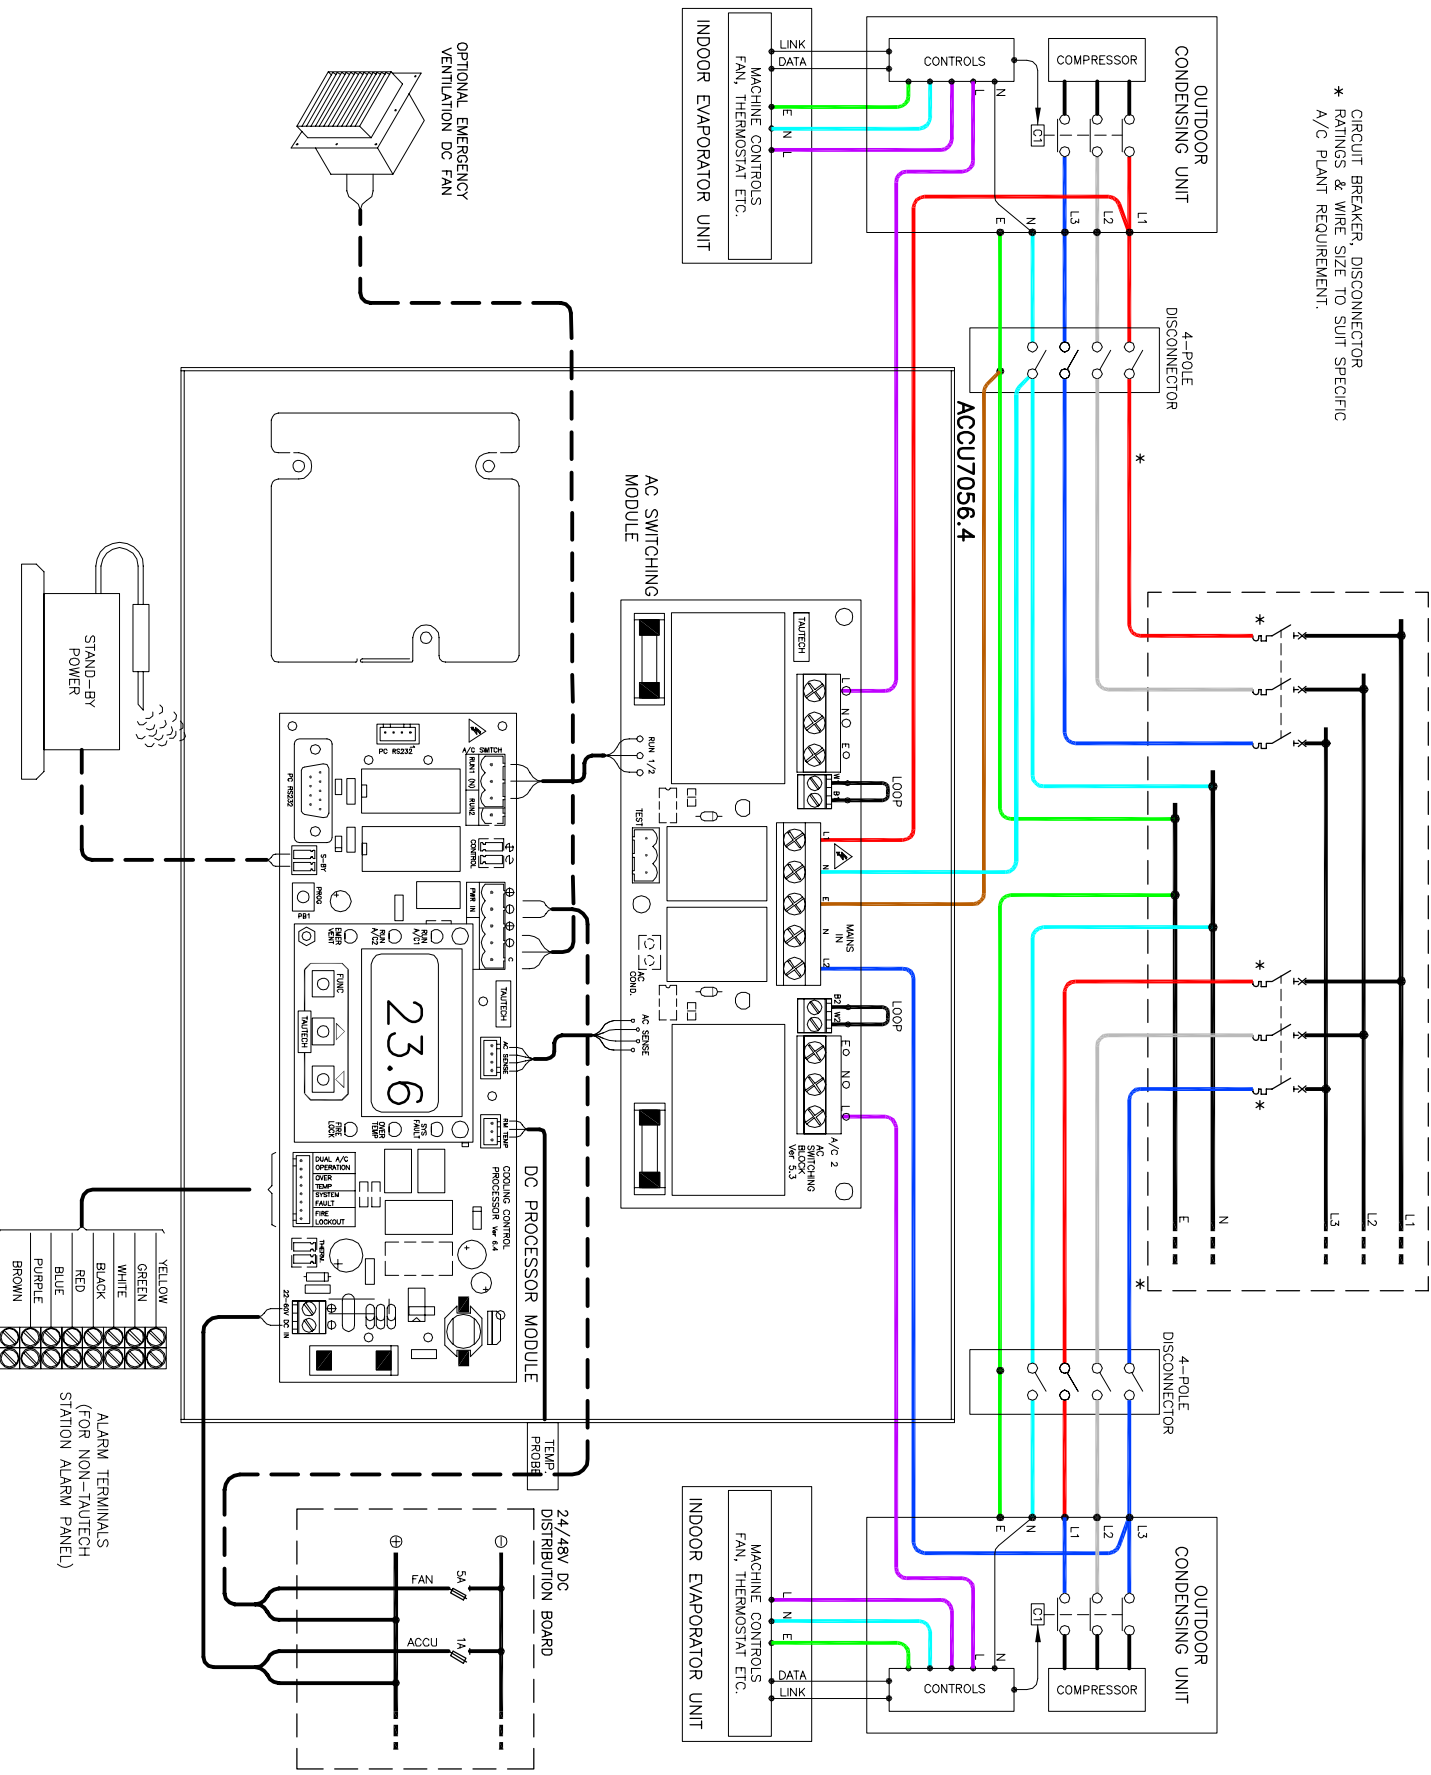

ASSOCIATED DRAWINGS	
No.	Description

REVISIONS		
No. Dat.	Description	Ckd.



79 Annie Botha Ave PO Box 55699  
 Strydom Ave PRETORIA  
 SOUTH AFRICA 0007  
 Tel: (+27 12) 329-2614  
 Fax: (+27 12) 329-2617  
 E-mail: info@tautech.co.za

CUSTOMER:  
 PROJECT:  
**AIR-CONDITIONING  
 CONTROL UNIT**

TITLE:  
**CONNECTION DIAGRAM FOR  
 MACHINES LARGER THAN 7KW,  
 THREE PHASE**

SCALE: N.T.S. DATE: JULY 2006  
 DESIGNED: CH. APPROVED:  
 DRAWING NO.: **ACCU7056.1T-CC3**

ALARM TERMINALS  
 (FOR NON-TAUTECH  
 STATION ALARM PANEL)

YELLOW
GREEN
WHITE
BLACK
RED
BLUE
PURPLE
BROWN