



AC DISTRIBUTION BOARD WITH SURGE SUPPRESSION

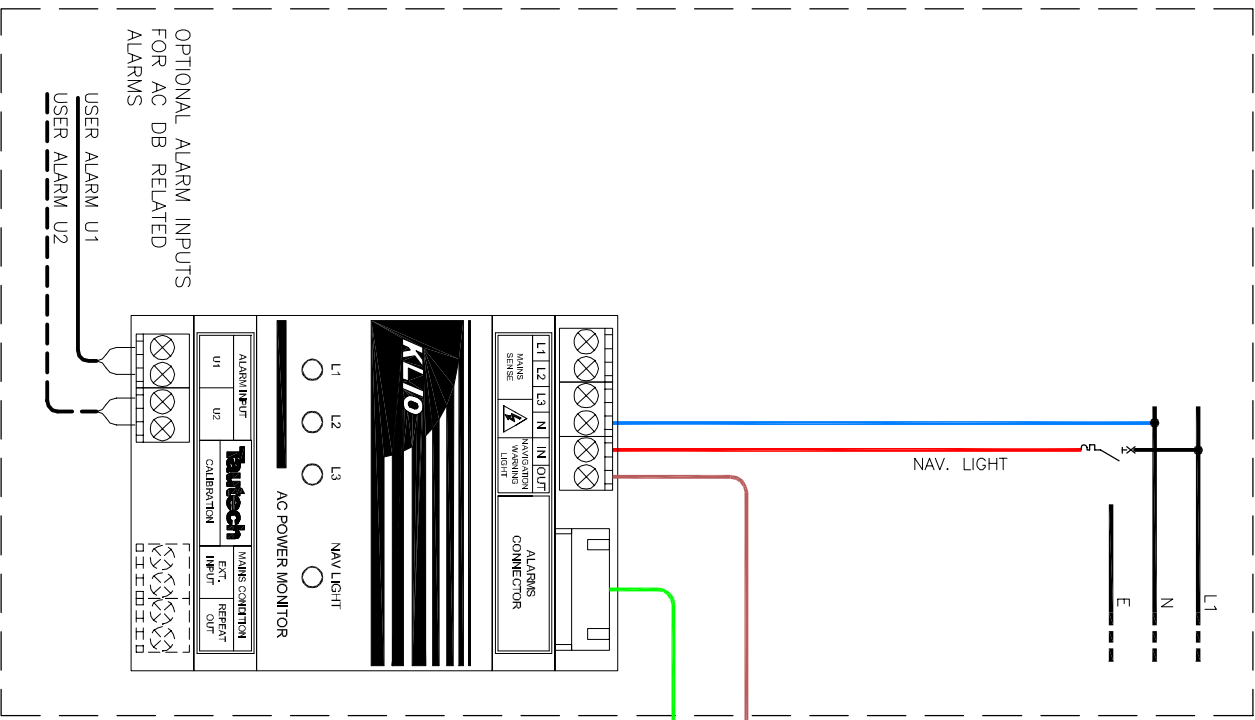

NAVIGATION WARNING LIGHTS

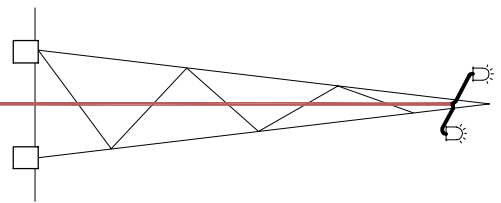


NAVIGATION WARNING LIGHT FAILURE SENSING APPLICATION TABLE

Fuse Rating (dA)	TOTAL INSTALLED LAMPS (WATT)			
	MINIMUM *	INCANDESCENT	COMPACT FLUORESCENT	MAXIMUM *
1 Amp	2 x 11	2 x 60	5 x 20	3 x 60
2 Amp	3 x 20	3 x 60	10 x 20	6 x 60

* OR EQUIVALENT WITHIN WATTAGE PER TYPE

VEGA STATION ALARM PANEL

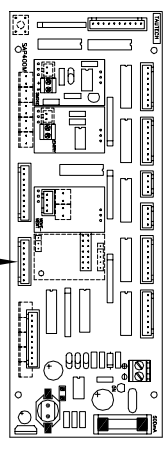

FIRST ANGLE

THE RIGHT TO USE THIS DRAWING IS ALLOWED TO THE PURCHASER OR MANUFACTURER ON THE EXPRESS UNDERSTANDING THAT IT IS USED TO DETAIL A STANDARD PRODUCT AND THAT ALL STEPS SHALL BE TAKEN TO PROTECT THIS DESIGN TO ITS OWNERS.

ASSOCIATED DRAWINGS

No.	Description
VEGA-SP#10	VEGA STATION ALARM PANEL - TYPICAL CONNECTION DIAGRAM
KL10-M	KL10 5/500/100/500-N CONNECTION DIAGRAM - MAINS FAIL ALARMS

REVISIONS

No. Dat.	Description	Ckd.



79 Annie Botha Ave PO Box 55699
 1000 Rhodesia PRETORIA
 SOUTH AFRICA
 Tel: (+27 12) 329-2814
 Fax: (+27 12) 329-2817
 E-mail: info@tautech.co.za

CUSTOMER:

PROJECT:

KL10 POWER MONITOR

TITLE:

CONNECTION DIAGRAM:
 NAVIGATION WARNING
 LIGHT ALARMS

SCALE: N.T.S. DATE: FEB '09
 DESIGNED: Q.R. APPROVED:
 DRAWING NO. **KL10 1A-2-2E2-N**